

Digital PID Controller V5.2

TS81E/ TS84E/ TS85E/ TS87E/ TS89E INSTRUCTION MANUAL

Carefully read all the instructions in this manual. TS8E052-E2
Please place this manual in a convenient location for easy reference.

Specification

- TS8E series instrument: 4 big LED display, 0-100% LED bar display output, Accuracy: (Max $\pm 0.2\%$ fus or ± 1 digit
RTD or TC input, the maximum resolution is 0.1 degree. Analog input, the maximum resolution is 0.001 degree.
- Please make sure that the power and output types are right before using, there is a wire diagram beside the controller, in the code NO4, you can see the output mode, such as relay, SSR or 4-20mA etc. (SEE 1. PRODUCT CHECK)
- Clients can set TC, RTD by keyboard, please set the input type coincide with the sensor. Check details of the manual "6.3" parameter INP1, If need analog signal inputs, please specified when order. (Except 0-20mV or 0-50mV input)
- As usual, controllers were set as out1 (heating) before leaving factory, of course, users can select out1 (cooling), check manual "6.3 Parameter Outd in level 2"
- PID control: As usual, controllers have PID control before leaving factory, with Auto-tuning function.
- ON/OFF Control: Set P=0.0, it will be changed as on/off control. Check manual "6.1 parameter P". Position difference is HYS. when heating: PV > SV, OUT stop, when PV < SV-HYS, OUT start, fitting for OUT1. When Cooling: PV > SV+HYS, output start, when PV < SV, output stop.
- Proportional control: when P $\neq 0$, I=0, d=0, which is purely Proportional control, Proportional reset is set as rSt, proportional cycle is Cyt. When heating, rSt value is smaller, then output is smaller. When cooling: rSt value is bigger, output is smaller.
- when PID Control, we suggest adopt the Autotuning to improve the control effect. Check "7. Autotuning"
- When analog signal output, can using output buffer function when in some special control position, which can make output more stable.
Check manual (6.1 level 2 bUFF parameter, and 6.3 level 2 bEr parameter)

1. PRODUCT CHECK

MODEL (Size: wideXhigh)

TS81E (48mmX48mm)

TS84E (48mmX96mm)

TS85E (96mmX48mm)

TS87E (72mmX72mm)

TS89E (96mmX96mm)

CODE

TS81E (48mmX48mm) ☐ ☐ ☐ ☐ - ☐ ☐ * ☐ ☐ - ☐ ☐ ☐

TS84E (48mmX96mm) ☐ ☐ ☐ ☐ - ☐ ☐ * ☐ ☐ - ☐ ☐ ☐

TS85E (96mmX48mm) ① ② ③ ④ ⑤ ⑥ ⑦ ⑧ ⑨

TS87E (72mmX72mm)

TS89E (96mmX96mm)

(1) Control action

N: No action

F: Reverse PID action (for Heating) D: Direct PID action (for cooling)

B: ON/OFF control (for heating) M: ON/OFF control (for cooling)

(2) Input type, (3) Range code: See "8. INPUT RANGE TABLE"

(4) Control output [OUT]

N: No action

M: Relay contact

2: Current (DC 0~20mA)

5: 0~5VDC

7: 1~5VDC

V: Voltage pulse (for SSR)

8: Current (DC 4~20mA)

6: 0~10VDC

T: Triac single phase zero crossing control

(5) Transmission

N: No transmission

C: PV transmission (4-20mA)

P: PV transmission (0-5V)

Q: PV transmission (0-10V)

E: SV transmission (4-20mA)

R: SV transmission (0-5V)

S: SV transmission (0-10V)

(6) Alarm 1 [AL1] (7) Alarm 2 [AL2]

A: Deviation high alarm

B: Deviation low alarm

C: Deviation high/low alarm

D: Deviation band alarm

E: Deviation high alarm with hold action

F: Deviation low alarm with hold action

G: Deviation high/low alarm with hold action

M: Deviation band alarm with hold action

H: Process high alarm

J: Process low alarm with hold action

K: Process high alarm with hold action

L: Process low alarm with hold action

(8) Power

A: 220VAC B: 85-265VAC


(9) Communication

N: No Communication 5: RS485 communication Modbus-RTU

2. MOUNTING SIZE

TS81E


(Unit:mm)

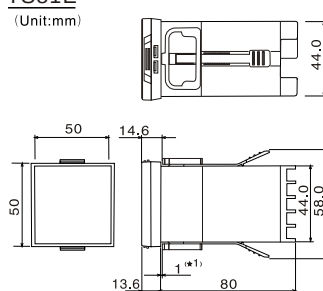

TS84E


TS85E

(Unit:mm)

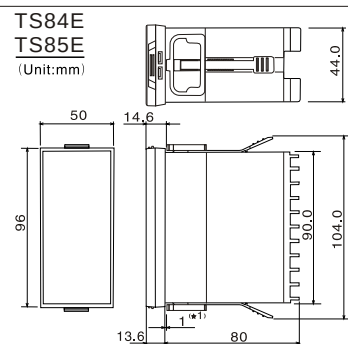


TS87E

(Unit:mm)

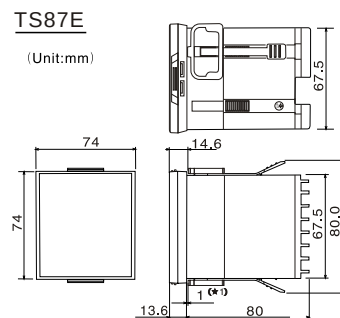


TS89E

(Unit:mm)

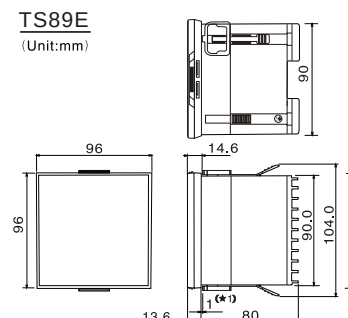


3. WIRING


TS81E

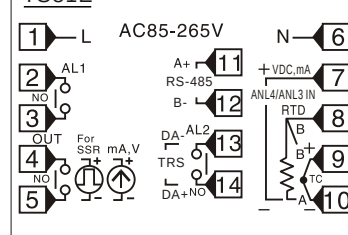


TS87E

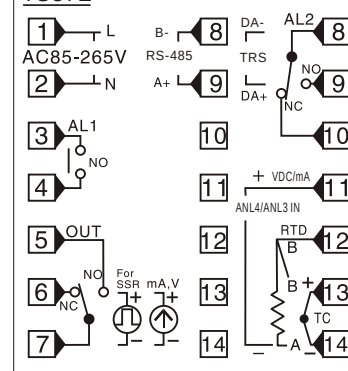

TS84E

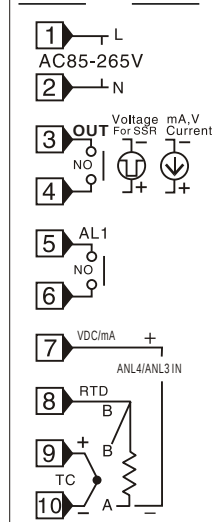


TS89E




Alarm output rated:
Relay contact output: 250V AC, 3A (Resistive load)
Control output rated:
Relay contact output: 250V AC, 5A (Resistive load)
Voltage pulse output: 0/12V DC or 0/24V DC (Load resistance 600 ohm or more)
Current output: 4 to 20mA DC (Load resistance 500 ohm or less)
Triac single phase zero crossing: 100A or less

3.1 Wiring cautions

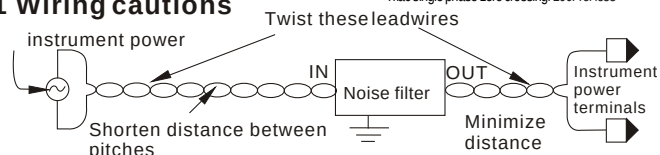


4. PARTS DESCRIPTION

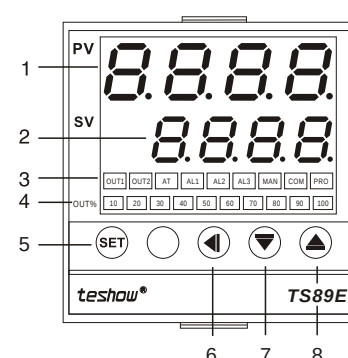

- 1 Measured value (PV) display [RED]
- 2 Set value (SV) display [GREEN]
- 3 OUT1 lamp: Output indication
OUT2 lamp: Remark lamp
AT lamp: Autotuning indication
AL1 lamp: Alarm 1 output indication
AL2 lamp: Alarm 2 output indication
AL3 lamp: Remark lamp
MAN lamp: Remark lamp
COM lamp: Communication indication
PRG lamp: Remark lamp
- 4 LED bar: Output 1 % value indication
- 5 SET key: Used for parameter calling up and set value registration
- 6 ◀ : Shift key and setting SV key
- 7 ▼ : Down key, decrease numbers
- 8 ▲ : Up key, increase numbers


5. SETTING

5.1 Calling up procedure of each mode

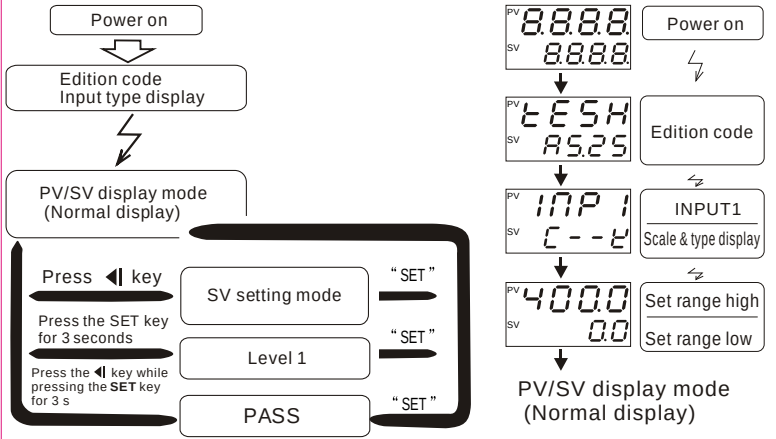

Display	<i>E</i>	<i>E</i>	<i>J</i>	<i>N</i>	<i>U</i>	<i>S</i>	<i>T</i>	<i>R</i>	<i>B</i>	<i>AN4</i>	<i>AN3</i>	<i>AN2</i>	<i>AN1</i>	<i>Pt</i>
Input	K	E	J	N	Wu3_Re25	S	T	R	B	2-10VDC 1-5VDC 4-20mA	0-10VDC 0-5VDC 0-20mA	0-50mV	0-20mV	Pt100
Range	1300 °C	600 °C	800 °C	1300 °C	2000 °C	1600 °C	400 °C	1700 °C	1800 °C					

5.2 Setting set value(SV)

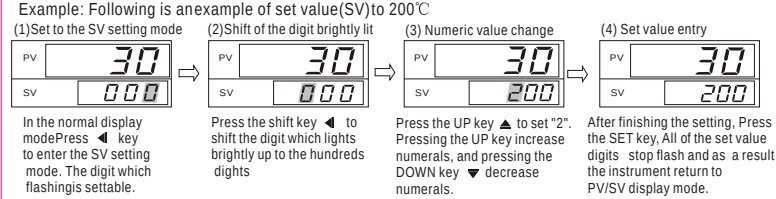

5.3 Setting parameters other than set value (SV)

The setting procedures are the same as those of example (2) to (4) in the above "Setting setvalue (SV)". Press the SET key after the setting end shifts to the next parameter. When no parameter setting is required, return the instrument to the PV/SV display mode.

6. LEVEL


*In any time you can press SET key for 3 seconds to save value and exit level to PV/SV mode.

6.1 Level 1

Press the SET key for 3 seconds to level 1. The following parameter symbols are displayed one by one every time the SET key is pressed. After the value is registered, when no parameter setting is required, Press the SET key for 3 s to return the instrument to the normal display.

Symbol	Name	Range	1#	Description
<i>At</i>	Autotuning	NO or YES	NO	YES: Autotuning on, NO: Autotuning off
<i>AL1</i>	Alarm 1	-1999 to 9999	10	Set the alarm value for alarm 1. Alarm differential gap=AH1
<i>AL2</i>	Alarm 2	-1999 to 9999	10	Set the alarm value for alarm 2. Alarm differential gap=AH2
<i>SC</i>	PV bias	-199 to 199	0.0	Sensor correction is made by adding bias value to measured value (PV).
<i>P</i>	Proportional band	0.0 to 200.0	30.0	Proportional band in PID with unit °C for OUT1 P=0.0, ON/OFF control
<i>HYS</i>	Control Hysteresis	0 to 999	1.0	Control out differential gap=HYS Only for ON/OFF action when P=0.0
<i>I</i>	Integral time	0 to 3600 s	240	Set the time of integral action to eliminate the offset occurring in proportional control.
<i>d</i>	Derivative time	0 to 3600 s	60	Set the time of derivative action to improve control stability by preparing for output changes.
<i>Cycle</i>	Proportioning Cycle	0 to 999 s	20	Proportioning cycle time for PID control
<i>rE</i>	Overshoot protection	0.0 to 100.0	10.0	Overshoot protection for first power on or SV modify later. (Auto setting after autotuning)
<i>rSt</i>	Proportional reset	-199 to 200	-5.0	Proportional reset for overshoot protection (Auto setting after autotuning)
<i>QPL</i>	Output limit (Low)	0.0 to 100.0%	0.0	Output manipulated variable lowest limit
<i>QPH</i>	Output limit (High)	0.0 to 100.0%	100.0	Output manipulated variable highest limit
<i>buff</i>	Output buffer	0.0 to 100%	100.0	Output variance value. percentage per second buffer limit. Only for 4-20mA output
<i>LCK</i>	Set data lock	0-2	0	LCK=0: Allow to modify any parameter and SV LCK=1: Only allow to modify SV and AT LCK=2: Not allow to modify any parameter and SV

6.2 PASS Press the 1# key while pressing the SET key for 3 s.

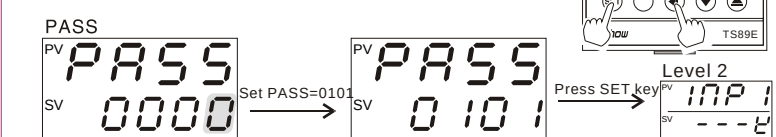

6.3 Level 2

Press the 1# key while pressing the SET key for 3 s to PASS, set PASS=0101, then press SET key to Level 2

The following parameter symbols are displayed one by one every time the SET key is pressed. After the value is registered, when no parameter setting is required, Press the SET key for 3 s to return the instrument to the normal display.


Symbol	Name	Range	1#	Description
<i>INP1</i>	Main input type select	Setting: <i>E</i> <i>E</i> <i>J</i> <i>N</i> <i>U</i> <i>S</i> <i>T</i> <i>R</i> <i>B</i> Input: K E J N Wu3_Re25 S T R B Range: 1300 °C 600 °C 800 °C 1300 °C 2000 °C 1600 °C 400 °C 1700 °C 1800 °C		
<i>dP</i>	Decimal point	0 to 3	0	0, 1 for TC or RTD or analog type 2, 3 Only for Linear analog type input
<i>LSPL</i>	Low setting	-1999 to 9999	0	Set lower setting limiter Lower point of transmission
<i>USPL</i>	High setting	-1999 to 9999	400	Set high setting limiter Higher point of transmission
<i>UNIT</i>	Display scale	C, F or A	C	<i>C</i> : Centigrade, <i>F</i> : Fahrenheit <i>R</i> : without scale
<i>PVfE</i>	PV follow-up PV input filter	0 to 60	55	PV variable-value control, 0-30: for general, 31-60: for enhanced
<i>ANL1</i>	Lowest value of PV display	-199-9999	0	Lowest value display when linear analog inputs , Such as 4-20mA input.
<i>ANH1</i>	Highest value of PV display	-1999-9999	2000	Highest value display when linear analog inputs , Such as 4-20mA input.
<i>ALd1</i>	Alarm1 mode	00 to 16	11	Select the type of alarm 1. See (**ALARM TYPE TABLE)
<i>ALd1</i>	Alarm1 differential gap	0.0 to 100.0	1.0	Alarm1 differential gap setting
<i>ALd2</i>	Alarm2 mode	00 to 16	10	Select the type of alarm 2. See (**ALARM TYPE TABLE)
<i>ALd2</i>	Alarm2 differential gap	0.0 to 100.0	1.0	Alarm2 differential gap setting
<i>OUd</i>	Control action	HEAT or COOL	HEAT	<i>HEAT</i> : Reverse action (Heating) <i>COOL</i> : Direct action (Cooling)
<i>BEr</i>	Buffer mode for out1 analog output	0, 1, 2	0	0: No buffer for analog output1 1: Always with buffer for analog output1 2: With buffer when the output1 increases only. (Soft-start) Output variance value. percentage per second buffer limit according BUFF in Level1
<i>IdNO</i>	Device address setting	0-127	1	Communication device address setting.
<i>BAUD</i>	Band-rate setting		9.6	BAUD=2.4K, 4.8K, 9.6K, 19.2K

**ALARM TYPE TABLE (ALD_ = 00-16)
10: No alarm output 00: No alarm output
11: Deviation high alarm 01: Deviation high alarm with hold action
12: Deviation low alarm 02: Deviation low alarm with hold action
13: Deviation high/low alarm 03: Deviation high/low alarm with hold action
14: Deviation band alarm 04: Deviation band alarm with hold action
15: Process high alarm 05: Process high alarm with hold action
16: Process low alarm 06: Process low alarm with hold action

NOTE: With hold action, When Hold action is ON, the alarm action is suppressed at start-up until the measured value enters the non-alarm range.

7. AUTOTUNING

When controller's power are just on, it will be good to autotuning when the measured value is far lower than the set value



Press SET key for 3 s to Level 1 Press 1# key to set At=YES
1, When begin to autotuning, AT lightflash, which means to begin to autotuning, if you want to exit from autotuning, please enter into the AT menu, set AT=no
2, In the middle of the autotuning, it is ON/OFF control, according to the different systems, temperature may have a big variance and the autotuning time is of a long short.
3, After finishing autotuning, AT light stops flashing, controller will automatically save P, I, d, rE, rSt parameters, then automatic return to the normal control state, controller will continue to run with new P, I, d, rE, rSt parameters value.

8. INPUT RANGE TABLE

Input type	Code
K	0 to 400 °C K A4 0 to 600 °C K A6 0 to 1300 °C K B3
E	0 to 200 °C E A2 0 to 400 °C E A4 0 to 600 °C E A6
J	0 to 400 °C J A4 0 to 600 °C J A6 0 to 800 °C J A8
T	0 to 200 °C T A2 0 to 300 °C T A3 0 to 400 °C T A4
S	0 to 1600 °C S B6
R	0 to 1700 °C R B7
B	200 to 1800 °C B B8
N	0 to 1300 °C N B3
Wu3_Re25	600 to 2000 °C W B0

Input type	Code
Pt100	0 to 400 °C D A4 0 to 600 °C D A6 0 to 800 °C D A8 -100 to +200 °C D C2 -200 to +800 °C D C8 -100.0 to +200.0 °C D F2 -50.0 to +200.0 °C D G2

Input type	Code
0 to 20mV	V 01
0 to 50mV	V 02
0 to 5VDC	V 03
0 to 10VDC	V 04
1 to 5VDC	V 08
2 to 10VDC	V 09
4 to 20mA	A 03
0 to 20mA	A 02

Note: Clients can set TC, RTD by keyboard, please set the input type coincide with the sensor. Check details of the manual "6.3 parameter INP1, If need analog signal inputs, please specified when order. (Except 0-20mV or 0-50mV input)